

Number	17-002982-PR02 (NW-K20-06-en-01)
Owner	Al Mimari Industrial Co. L.L.C PVC Windows & Doors PO Box 52646 Mussafah Abu Dhabi Industrial City United Arab Emirates
Product	Plastic profiles, profile combination: casement - frame System: 4-K System
Designation	
Details	Material Polyvinyl Chloride unplasticized (PVC-U); Projected width 128 mm; Structural depth 60 mm; Casement: Designation FR 60- 4; Cross section (W x T) 80 mm x 72 mm; Thickness of infill 28 mm; Edge cover of infill 13 mm; Reinforcement material Metals - Steel - galvanized; Dimension reinforcement 29 mm x 33 mm x 1,5 mm; Frame: Designation BR 76-4; Cross section (W x T) 77 mm x 60 mm; Reinforcement material Metals - Steel - galvanized; Dimension reinforcement 40 mm x 30 mm x 1,5 mm
Special features	
Result	

Thermal transmittance according to EN 12412-2:2003-07



$$U_f = 1.5 \text{ W/(m}^2\text{K)}$$


Basis *)

EN 12412-2:2003-07

*)and corresponding national versions
e.g. DIN EN

Test report: 17-002982-PR02 PB-K20-06-en-01

Representation

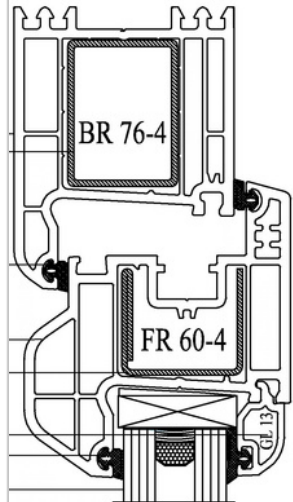

The test was done without insulating glazing.

Instructions for use

The results obtained can be used as evidence in accordance with the above basis.

Validity

There is no time limit.

When using this document the up-to-dateness of above basis and the conformity of the product have to be observed.

The data and results given relate tested/described solely to the test/evaluation specimen. This does not allow any statement to be made on further characteristics of the present structure regarding performance and quality. Notes on publication The ift-Guidance Sheet "Conditions and Guidance for the Use of ift Test Documents" applies.



ift Rosenheim
30.05.2018

Konrad Huber

Konrad Huber, Dipl.-Ing. (FH)
Head of Testing Department
Building Physics

S. Junker

Stefan Junker, Dipl.-Ing. (FH)
Operating Testing Officer
Building Physics

Identity-Check



www.ift-rosenheim.de/ift-geprueft
ID: ACC-A264F